


Catnic Lintel Psi values (5-2-15) Separate Lintels Full Fill cavity Wall Construction

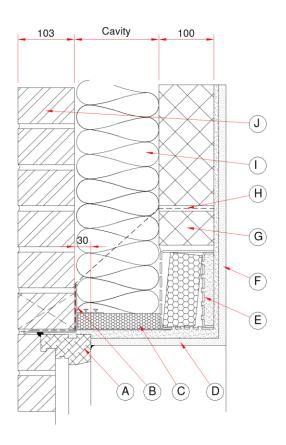

	Materials	Thickness (mm)	λ Value (W/m.K)
A	Window frame	~	~
(B)	Catnic ANG Lintel		
(C)	Insulated PVC-U Cavity Closer		
D	Plasterboard	12.5	0.19
	+ Adhesive	10.0	0.09
E	Catnic Insulated Box Lintel		
F	Plasterboard or	12.5	0.19
	Dabs + Air Spa	ce 10.0	0.09
G	Blockwork	100	0.11
H	DPC Tray	0.8	0.24
(1)	Insulation	See Table	0.037
J	Brick	103	0.77
Lintel	Steel	~	52
	Insulation	~	0.038
Comment:	Continuous band of adhesive to soffit area		

Cavity (mm)	Psi value (W/m.K)	
100	0.010	
125	0.016	
150	0.020	

To limit the risk of surface condensation or mould growth the temperature factor for a detail used in the external wall of a dwelling must be greater than 0.75. The above details all have temperatures factors greater than 0.9.

All calculations have been carried out following the conventions set out in BR 497.

Catnic